



Logging Form

Meter ID: FLUKE 289 V1.16 98270037 Tom Edwards

Reason for Log: Testing

Form Saved Time: 8/5/2016 8:15:24 AM

Upload Time: 8/5/2016 8:13:02 AM


Start Time	8/4/2016 4:23:27 PM				
Stop Time	8/5/2016 8:00:13 AM				
Elapsed Time	15:36:46				
Interval	0:00:10				
Readings (All, Intervals, Events)	9210 / 5621 / 3991				
Logging Setup	Setting when uploaded: 4%				
Session Name	Save 18				
	Max Time	Max	Average	Min	Min T
	2:28:43 AM	0.6216 A DC	0.3158 A DC	0.0001 A DC	2:29:

Test Purpose:

Backup Battery discharge test with an ATI IMG-2426F ONT. The test was conducted with a new battery with an unknown charge. There was no load on the ONT and the voice was registered.

Graph Name:

Show Data: All Graph View: All

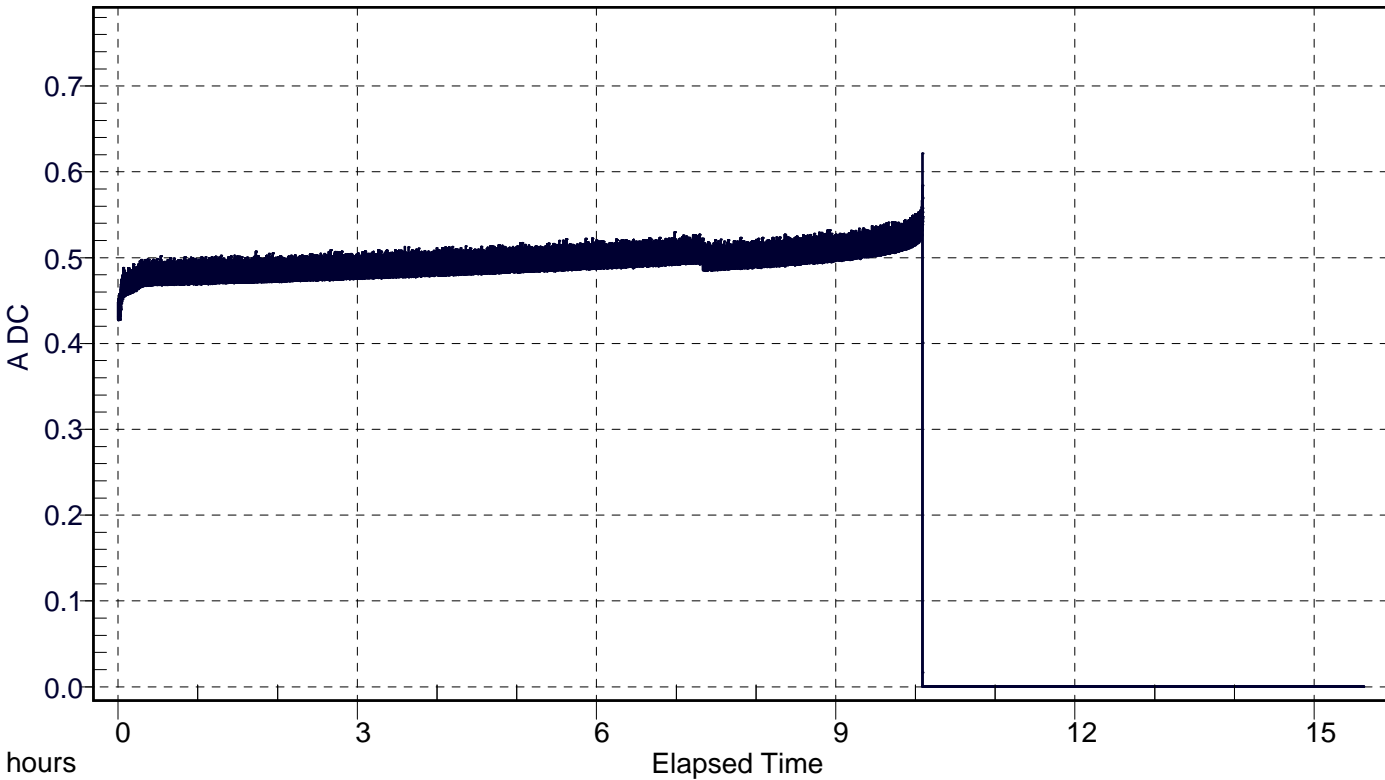

A	Sample	Start Time	Duration	Max Time	Max	Average	Min Time	Min	D
9198	0.0002 A DC	7:58:17 AM	0:00:10.0	7:58:18 AM	0.0003 A DC	0.0002 A DC	7:58:17 AM	0.0002 A DC	I
9199	0.0002 A DC	7:58:27 AM	0:00:10.1	7:58:27 AM	0.0003 A DC	0.0002 A DC	7:58:27 AM	0.0002 A DC	I
9200	0.0002 A DC	7:58:37 AM	0:00:10.0	7:58:39 AM	0.0003 A DC	0.0003 A DC	7:58:37 AM	0.0002 A DC	I
9201	0.0003 A DC	7:58:47 AM	0:00:10.0	7:58:47 AM	0.0003 A DC	0.0003 A DC	7:58:55 AM	0.0002 A DC	I
9202	0.0002 A DC	7:58:57 AM	0:00:10.1	7:58:57 AM	0.0002 A DC	0.0002 A DC	7:58:57 AM	0.0002 A DC	I
9203	0.0002 A DC	7:59:07 AM	0:00:10.0	7:59:07 AM	0.0003 A DC	0.0002 A DC	7:59:07 AM	0.0002 A DC	I
9204	0.0002 A DC	7:59:17 AM	0:00:10.0	7:59:17 AM	0.0002 A DC	0.0002 A DC	7:59:17 AM	0.0002 A DC	I
9205	0.0002 A DC	7:59:27 AM	0:00:10.1	7:59:32 AM	0.0003 A DC	0.0002 A DC	7:59:28 AM	0.0001 A DC	I
9206	0.0002 A DC	7:59:37 AM	0:00:10.0	7:59:37 AM	0.0002 A DC	0.0002 A DC	7:59:37 AM	0.0002 A DC	I
9207	0.0002 A DC	7:59:47 AM	0:00:10.1	7:59:55 AM	0.0003 A DC	0.0002 A DC	7:59:47 AM	0.0002 A DC	I
9208	0.0003 A DC	7:59:57 AM	0:00:10.0	7:59:57 AM	0.0003 A DC	0.0003 A DC	8:00:04 AM	0.0002 A DC	I
9209	0.0002 A DC	8:00:07 AM	0:00:06.5	8:00:07 AM	0.0003 A DC	0.0003 A DC	8:00:07 AM	0.0002 A DC	S