



Logging Form

Meter ID: FLUKE 289 V1.16 98270037 Tom Edwards

Reason for Log Testing

Form Saved Time: 1/9/2019 8:14:05 AM

Upload Time: 1/9/2019 8:08:46 AM

Start Time	1/7/2019 8:20:07 AM				
Stop Time	1/9/2019 7:51:06 AM				
Elapsed Time	47:30:59				
Interval	0:05:00				
Readings (All, Intervals, Events)	577 / 571 / 7				
Logging Setup	Setting when uploaded: 4%				
Session Name	Save 38				
	Max Time	Max	Average	Min	Min
	1:18:00 AM	0.5306 A DC	0.3896 A DC	-0.0006 A DC	1:20


Test Purpose:

Calix 717GE ONT Maximum Run Time (On-Hook) test with CyberPower CS30U12V-20 battery backup.

Battery - DJW12-20 (12V/20Ah)

Graph Name:

Show Data: All Graph View: All

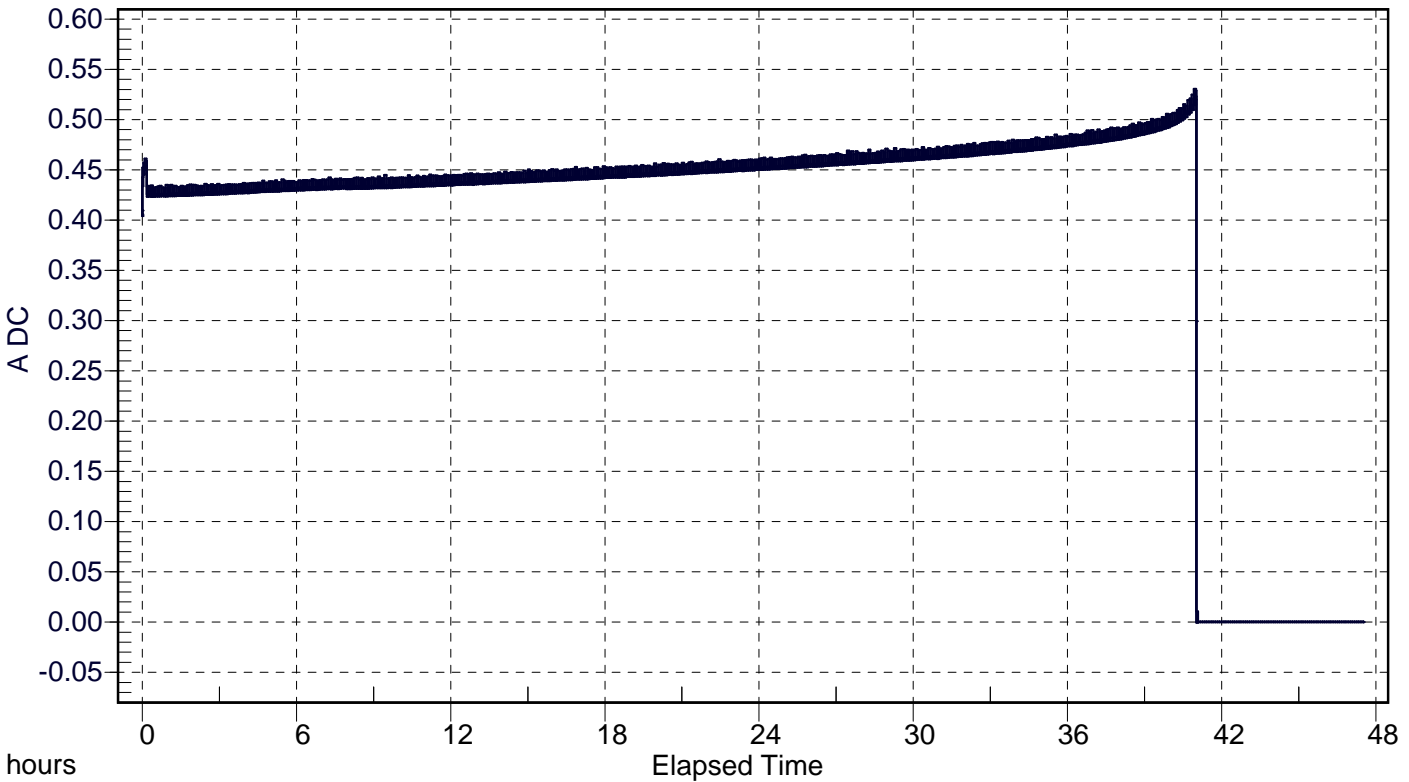

A	Sample	Start Time	Duration	Max Time	Max	Average	Min Time	Min
568	0.0002 A DC	7:10:06 AM	0:05:00.0	7:10:22 AM	0.0003 A DC	0.0002 A DC	7:10:06 AM	0.0002 A DC
569	0.0003 A DC	7:15:06 AM	0:05:00.1	7:15:06 AM	0.0003 A DC	0.0002 A DC	7:15:42 AM	0.0001 A DC
570	0.0002 A DC	7:20:06 AM	0:05:00.0	7:20:23 AM	0.0003 A DC	0.0002 A DC	7:20:06 AM	0.0002 A DC
571	0.0002 A DC	7:25:06 AM	0:05:00.0	7:25:40 AM	0.0003 A DC	0.0002 A DC	7:28:04 AM	0.0001 A DC
572	0.0002 A DC	7:30:06 AM	0:05:00.1	7:30:07 AM	0.0003 A DC	0.0002 A DC	7:32:54 AM	0.0001 A DC
573	0.0003 A DC	7:35:06 AM	0:05:00.0	7:35:06 AM	0.0003 A DC	0.0002 A DC	7:35:38 AM	0.0001 A DC
574	0.0002 A DC	7:40:06 AM	0:05:00.0	7:40:20 AM	0.0003 A DC	0.0002 A DC	7:40:06 AM	0.0002 A DC
575	0.0002 A DC	7:45:06 AM	0:05:00.1	7:45:07 AM	0.0003 A DC	0.0002 A DC	7:48:39 AM	0.0001 A DC
576	0.0002 A DC	7:50:06 AM	0:01:00.0	7:50:22 AM	0.0003 A DC	0.0002 A DC	7:50:06 AM	0.0002 A DC
577	0.0002 A DC	7:51:06 AM	0:00:00.0					