



Logging Form

Meter ID: FLUKE 289 V1.16 98270037 Tom Edwards

Reason for Log

Form Saved Time: 8/18/2016 3:43:59 PM

Upload Time: 8/18/2016 3:43:13 PM


Start Time	8/17/2016 4:30:38 PM			
Stop Time	8/18/2016 12:30:37 PM			
Elapsed Time	19:59:59			
Interval	0:00:10			
Readings (All, Intervals, Events)	7203 / 7201 / 3			
Logging Setup	Setting when uploaded: 4%			
Session Name	Save 19			
	Max Time	Max	Average	Min
	10:31:17 AM	0.493 A DC	0.398 A DC	0.000 A DC
	Min Time			

Test Purpose:

Discharge test of Calix ONT. There were no ports connected and the VoIP was registered. This was a maximum standby time test for battery runtime.

Graph Name:

Show Data: All Graph View: All

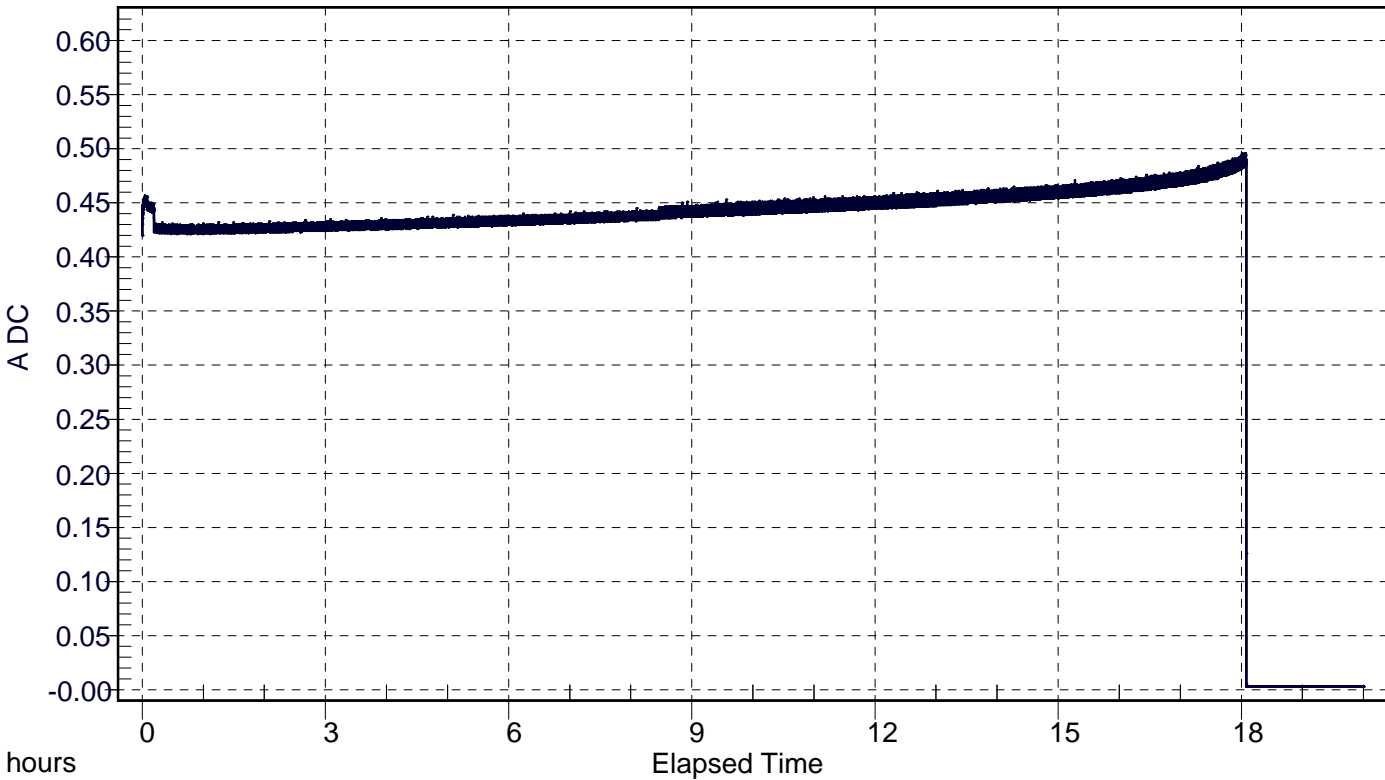

A	Sample	Start Time	Duration	Max Time	Max	Average	Min Time	Min	Descr
7194	0.000 A DC	12:29:17 P	0:00:10.1	12:29:17 P	0.000 A DC	0.000 A DC	12:29:17 PM	0.000 A DC	Interv
7195	0.000 A DC	12:29:27 P	0:00:10.0	12:29:27 P	0.000 A DC	0.000 A DC	12:29:27 PM	0.000 A DC	Interv
7196	0.000 A DC	12:29:37 P	0:00:10.0	12:29:37 P	0.000 A DC	0.000 A DC	12:29:37 PM	0.000 A DC	Interv
7197	0.000 A DC	12:29:47 P	0:00:10.1	12:29:47 P	0.000 A DC	0.000 A DC	12:29:47 PM	0.000 A DC	Interv
7198	0.000 A DC	12:29:57 P	0:00:10.0	12:29:57 P	0.000 A DC	0.000 A DC	12:29:57 PM	0.000 A DC	Interv
7199	0.000 A DC	12:30:07 P	0:00:10.1	12:30:07 P	0.000 A DC	0.000 A DC	12:30:07 PM	0.000 A DC	Interv
7200	0.000 A DC	12:30:17 P	0:00:10.0	12:30:17 P	0.000 A DC	0.000 A DC	12:30:17 PM	0.000 A DC	Interv
7201	0.000 A DC	12:30:27 P	0:00:10.0	12:30:27 P	0.000 A DC	0.000 A DC	12:30:27 PM	0.000 A DC	Interv
7202	0.000 A DC	12:30:37 P	0:00:00.1	12:30:37 P	0.000 A DC	0.000 A DC	12:30:37 PM	0.000 A DC	Stabl
7203	0.000 A DC	12:30:37 P	0:00:00.0						Loggi